


# TYPICAL FIRE HYDRANT INSTALLATION

## Notes:

1. Keep drain holes unclogged and free of debris.
2. Hydrant shall be manufactured by the Mueller Co. or City of Greenville approved equal. ( 5.25" barrell, (2) 2.5" connectors and (1) 4.5" connector)
3. Restrainers, as required, to be Anchor couplings for fire hydrant and Mega Lug for all other connections, or City of Greenville approved equal.
4. Paint Silver.
5. Steamer nozzle facing road.

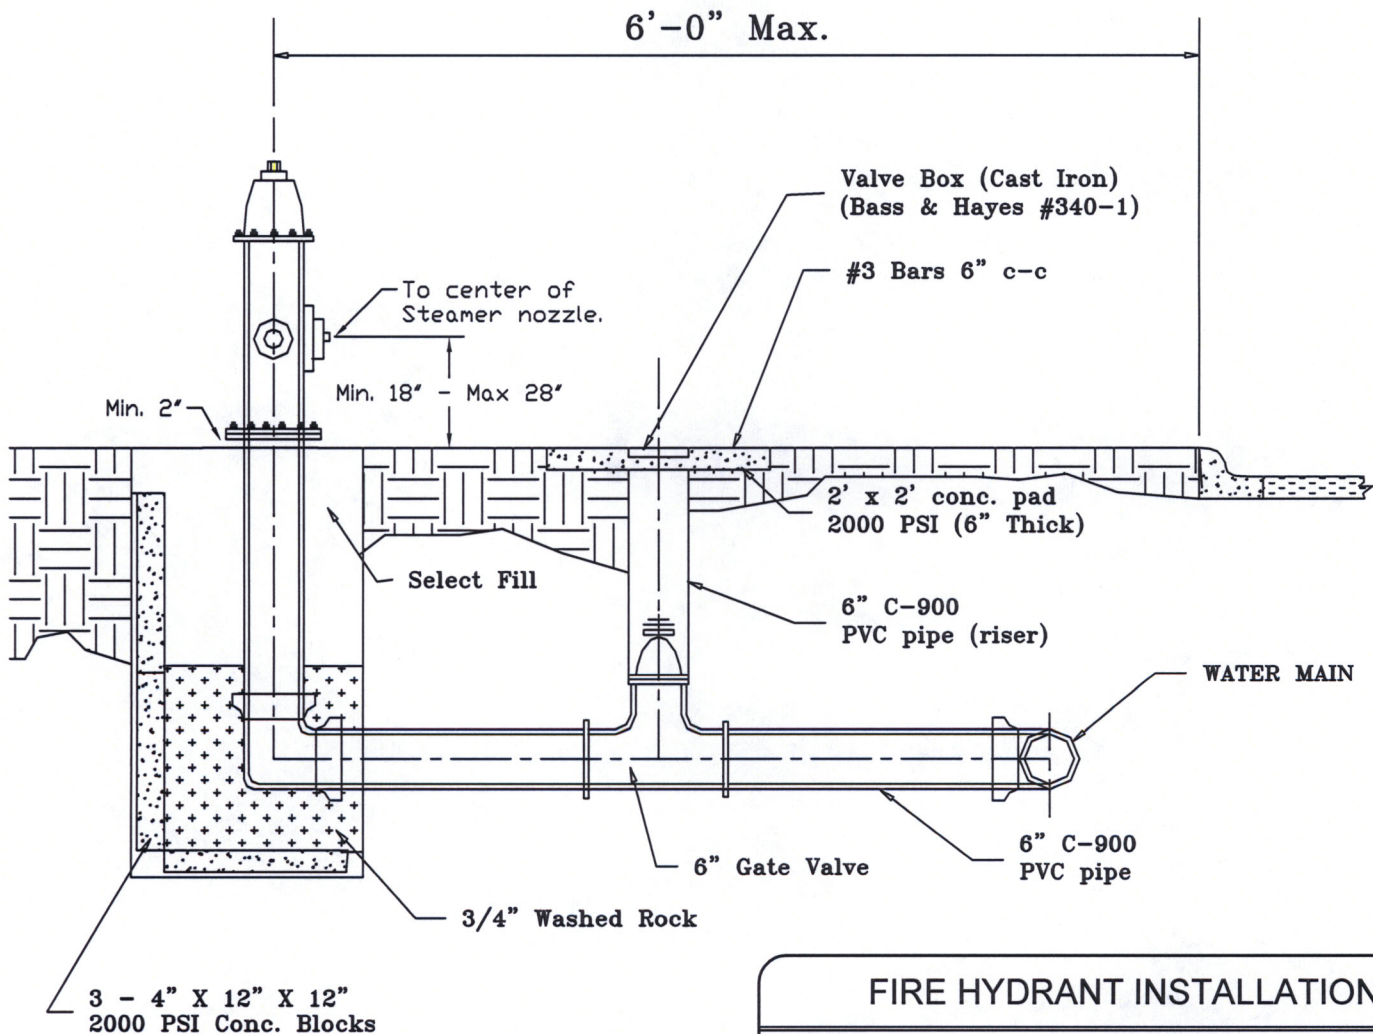

## FIRE HYDRANT INSTALLATION



CITY OF GREENVILLE  
PUBLIC WORKS DEPARTMENT

DRAWN: K. Colbert

SCALE: NTS

DATE DRAWN:  
2-14-01

DATE REVISED:  
8-15-07

DRAWING NO.  
26004